



INSTALLATION AND SERVICE MANUAL

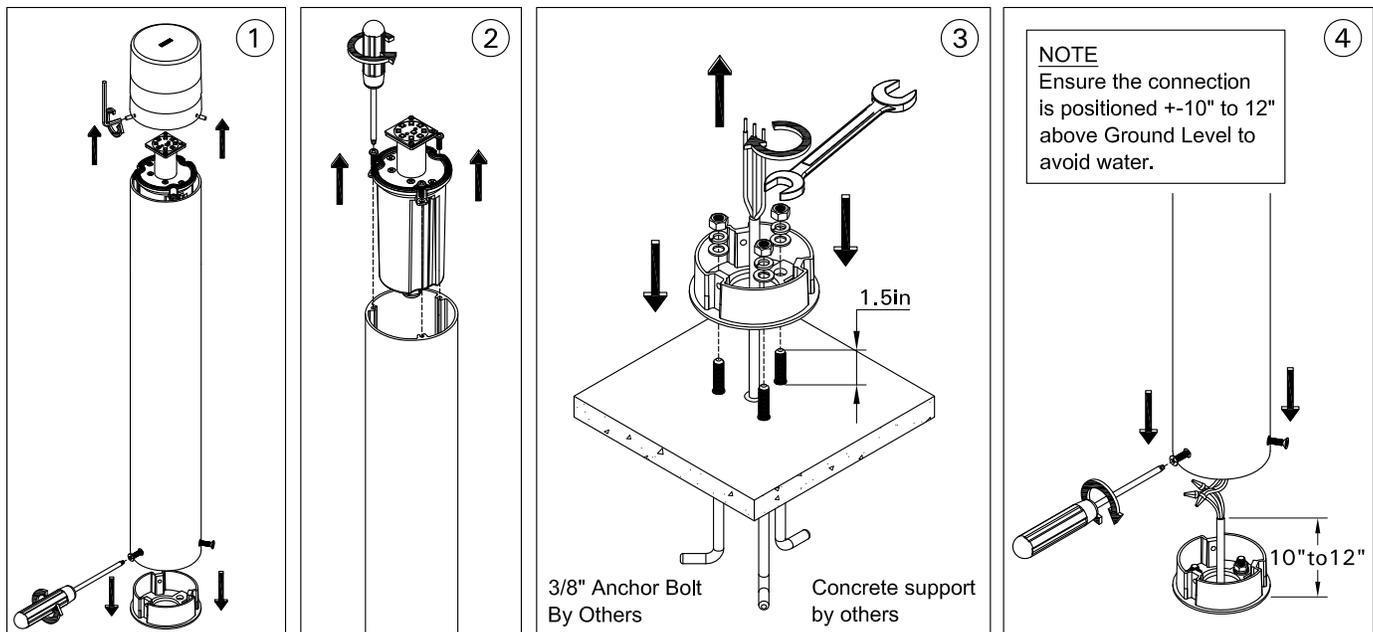

For installation of Mini lightsoft bollard LED.
 Model. ULH-10574, ULH-10584, ULH-10594, ULH-10604.

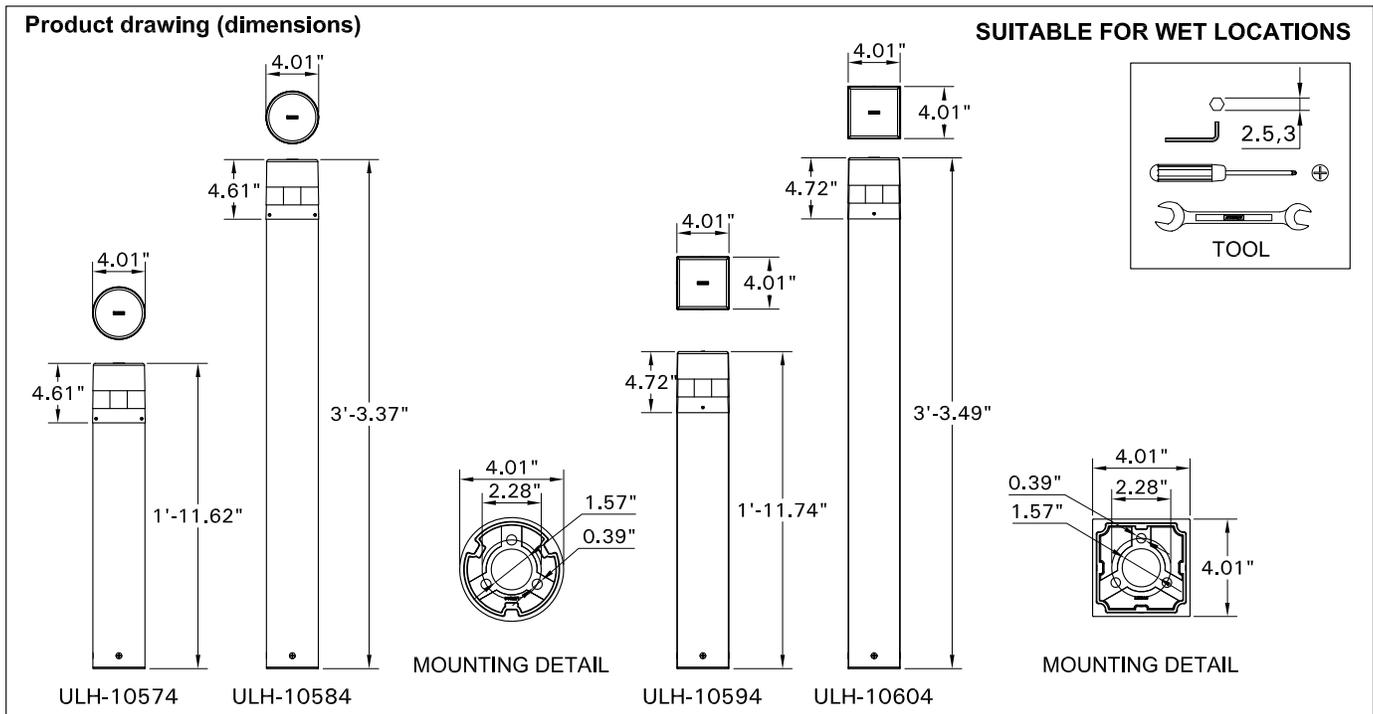

Notice to installer :

- 1.WIRING INSTRUCTIONS** Warning : RISK OF FIRE AND ELECTRICAL SHOCK. : FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY>FIXTURE IS INTENDED FOR INSTALLATION IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE, LOCAL AND FEDERAL CODE SPECIFICATIONS. DISCONNECT POWER BEFORE SERVICING.
- 2.This fixture has a VOLTAGE SPECIFIC BALLAST,Check that the supply voltage is the same as the installed ballast voltage.**

Ligman Lighting USA

7144 NW Progress Court, Hillsboro
 Oregon, 97124, USA
 Tel : 503 645 0500 | Fax : 503 645 8100

www.ligmanlightingusa.com

ULH-10574 04/09/14 REV.0
 1/2



FM-TS-13/25-05-2007-REV.2

