



## For installation of Replacement Lens for Illuminated Pole. Model. APD-IP-RSA-5510.


### Product drawing (dimensions)

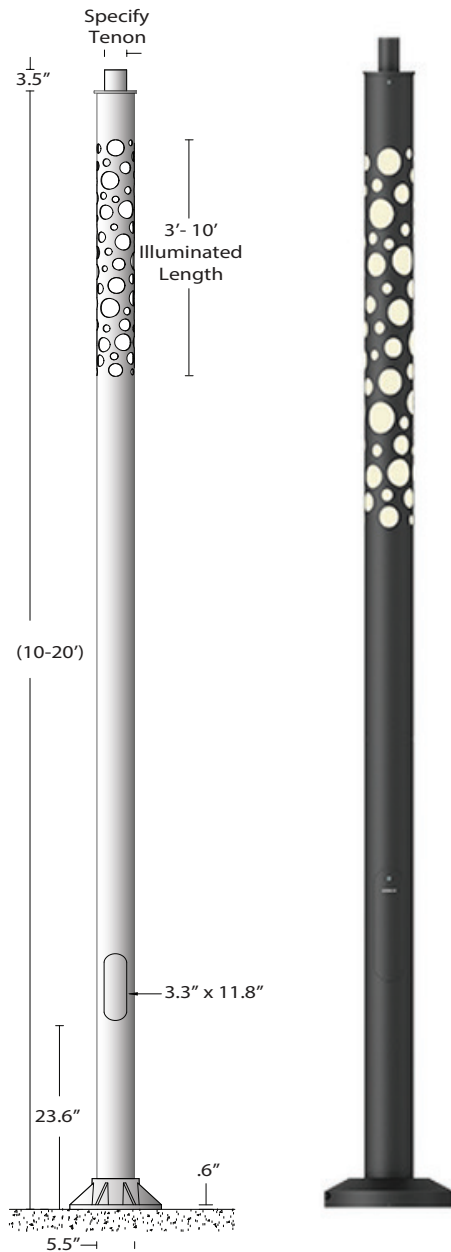


### 1. Remove the screw and illuminated set from the pole.

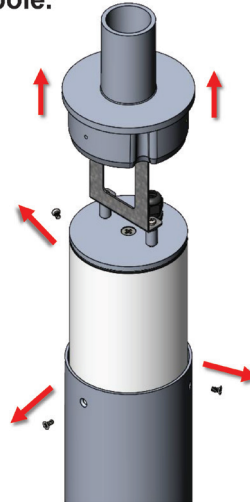


### 2. Remove the tenon set from the top cap.

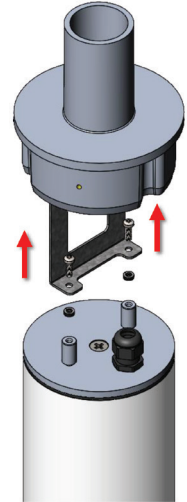

### 3. Remove the screw, O-Ring, top cap and gasket.

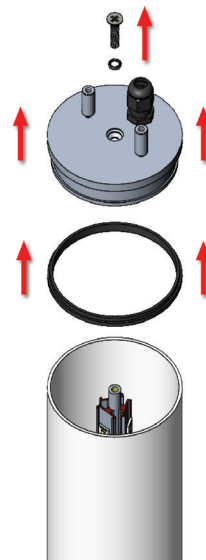

### 4. Remove the old lens.

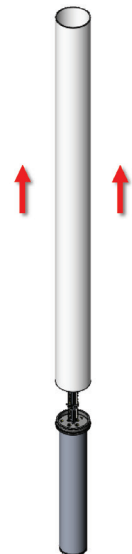

### Notice to Installer

#### Wiring Instruction ⚠ Warning:

- Risk of Fire and Electrical Shock, This fixture must be installed only by a qualified electrician, Installation must adhere to the National Electrical Code (NEC) and all applicable local and federal regulations.
- Always disconnect power before servicing the fixture.


7144 NE Progress Court, Hillsboro  
Oregon, 97124, USA  
Tel : 503 645 0500 | Fax : 503 645 8100

[www.ligmanlightingusa.com](http://www.ligmanlightingusa.com)


FM-TS-13-2/28-01-2565/Rev.4

**For installation of Replacement Lens for Illuminated Pole.  
Model. APD-IP-RSA-5510.**

**5. Install a new lens.**

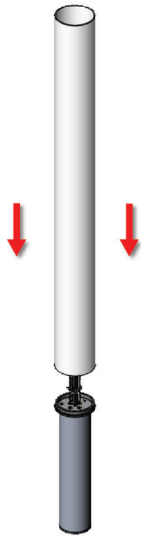


**6. Install the screw, o-ring, top cap and gasket.**

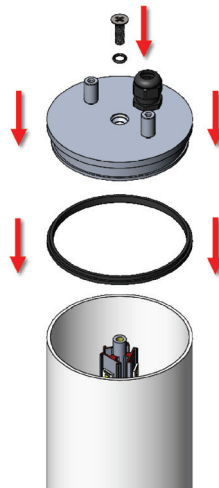


**Torq: 44.25 Inch-pound**

**7. Install the tenon set onto the top cap.**

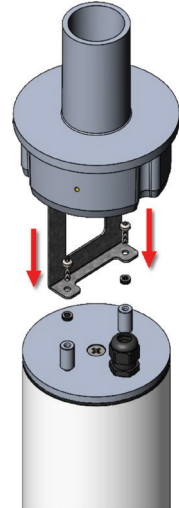

**Torq: 26.55 Inch-pound**

**8. Install the illuminated set and screw onto the pole.**

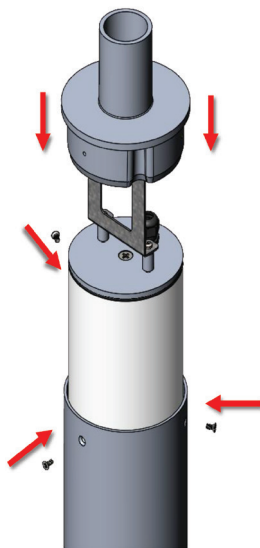

**Torq: 46.55 Inch-pound**

**9. Finish.**



**Notice to Installer**

**Wiring Instruction ⚠ Warning:**

- Risk of Fire and Electrical Shock, This fixture must be installed only by a qualified electrician, Installation must adhere to the National Electrical Code (NEC) and all applicable local and federal regulations.
- Always disconnect power before servicing the fixture.

7144 NE Progress Court, Hillsboro  
Oregon, 97124, USA  
Tel : 503 645 0500 | Fax : 503 645 8100